


1		2		3		4		5		6		7		8			
지시회로용 기호	지시회로 모사기호	지시회로 용기호	구분	0.5	6	30	120	315	1000	표준기호							
			구분	0.5	6	30	120	315	1000	12.5	0.3	32	1.6	0.8	0.2	0.1	
			구분	0.5	6	30	120	315	1000	1005	505	255	125	6.35	3.25	0.85	0.45
			구분	0.5	6	30	120	315	1000	대형	~	▽	▽▽	▽▽▽	▽▽▽▽		

TAG NO.		DSH-01		
ACTION	a	N	b	
OPEN	×	×	○	
CLOSE	○	×	×	
STOP	×	○	×	

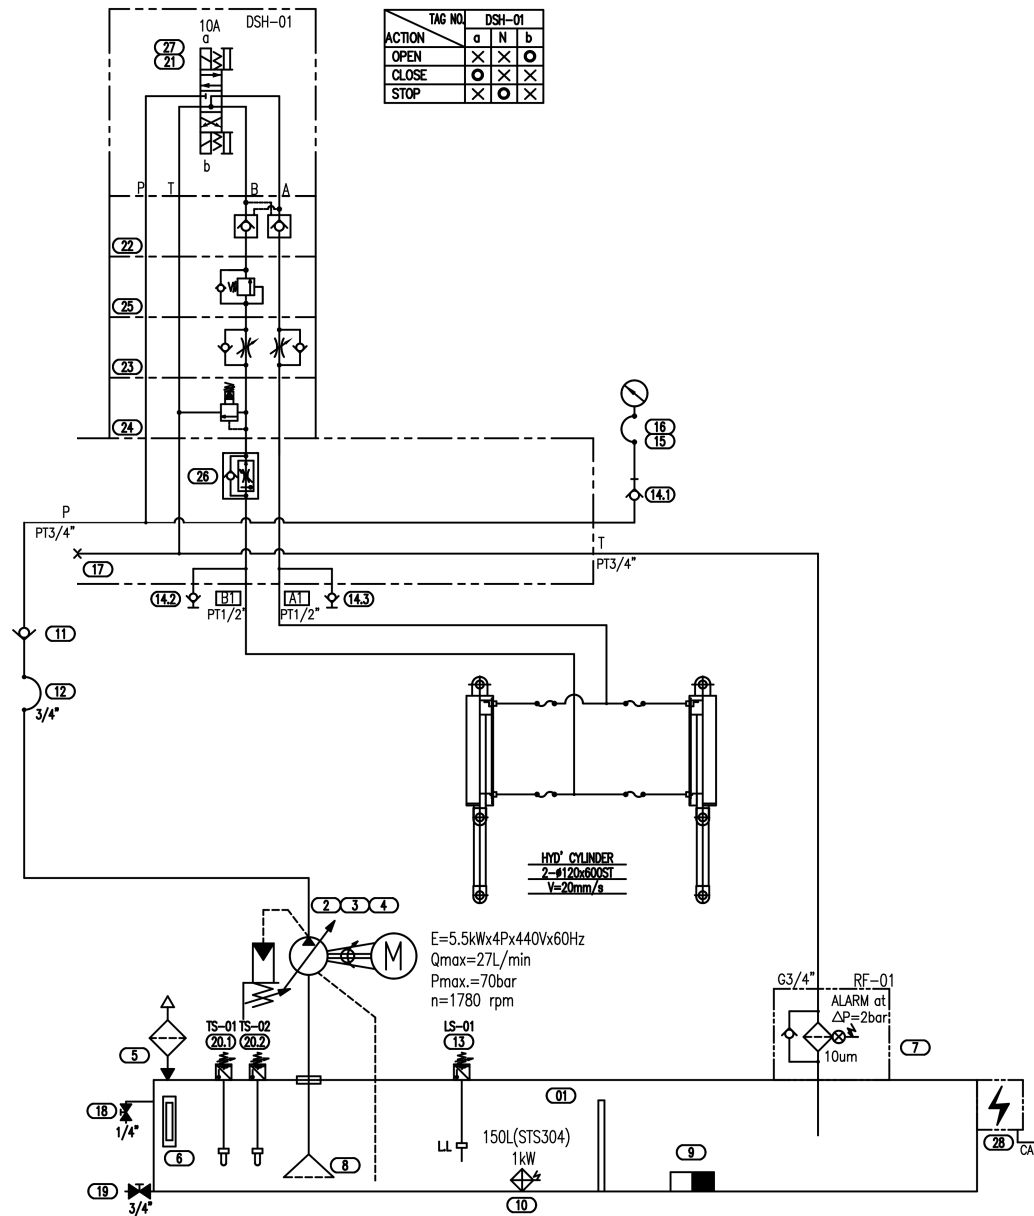

NO.	NAME OF PARTS	SPECIFICATION	MAKER	QTY	REMARKS
1	TANK	150L (STS304)	SGHITEC	1	
2	PISTON PUMP	AR22-FR01C-22	YUKEN	1	
3	BELL HOUSING&COUPLING	SPECIAL	Y.K.R	1	
4	ELECTRIC MOTOR	5.5KWx4Px440Vx60Hz(B3B5)	HICO	1	
5	AIR BREATHER	SH-AB-1380	SHC	1	
6	LEVEL GAUGE	SH-C-150-M16	SHC	1	
7	RETURN FILTER	RF ON 110 D C 10 B1.X	HYDAC	1	
8	SUCTION ELEMENT	SH-SE-08(PT 1")	SHC	1	
9	MAGNET	MP-100	K.S	1	
10	ELEC.HEATER	1kW x 440V	K.S	1	
11	CHECK VALVE	CT-06-05-30	YUKEN	1	
12	HYD HOSE	3/4" x 140bar	K.S	1	
13	LEVEL SWITCH	LL LEVEL (1SP)	K.S	1	
14	TEST POINT	PT1/4"	K.S	3	
15	TEST HOSE	M16x2P-1500L	K.S	1	
16	PRESSURE GAUGE	63-BD-250(PT1/4)	YUKEN KOREA	1	
17	MANIFOLD BLOCK	SPECIAL	Y.K.R	1	
18	BALL VALVE	1/4" x 10K	K.S	1	
19	GATE VALVE	3/4" x 10K	K.S	1	
20	THERMOSTAT	0-110°C	EGO	2	
21	SOL. VALVE	DSG-03-3C4-A100-50	YUKEN	1	
22	PILOT CHECK VALVE	MPW-03-2-70	YUKEN	1	
23	THROTTLE CHECK VALVE	MSW-03-Y-70	YUKEN	1	
24	RELIEF VALVE	MBB-03-C-70	YUKEN	1	
25	COUNTER BALANCE VALVE	MHB-03-B-2010	YUKEN	1	
26	FOW CONTROL VALVE	FCO-02-30-30	YUKEN	1	
27	BOLT KIT	MBK-03-04-10	YUKEN	1	
28	CONTROL PANEL	SPECIAL (STS304)	SGHITEC	1	
29	REMOTE SWITCH	SPECIAL	SGHITEC	1	

— SPECIFICATION —

- PRESSURE : WORKING PRESSURE= 70 Bar
- HYDRAULIC FLUID MEDIUM : MINERAL OIL ISO VG 46cSt
- VISCOSITY : ISO VG 46 cSt at 40°C
- ELECTRIC SOURCE: ELEC. POWER - 440VAC / 60Hz
: SOLENOID VALVE - AC110V
- PIPING MATERIAL : STS304

NO.		NAME OF PARTS		SPECIFICATION		MAKER		QTY		REMARKS	
TITLE: SLUDGE CAKE HOPPER 유압장치(동호안) 정확시설 HYD UNIT - CIRCUIT DIAGRAM											
FOR APPROVAL				DESIGN TEAM				PROJECTION METHOD			
REVISION & DESCRIPTION				DRAWN				THIRD ANGLE PROJECTION			
DATE				CHECKED				SCALE 1/3			
				APPROVED				JOB NO.			
				DRAWN				DWG NO. SGT-2412-02-HPU			
				CHECKD				CLIENT DOC. NO.			
				CHECKD				DWG NO. SGT-2412-02-HPU			

SGHITEC